


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\W-1.00.dwg Dec 29 , 2010 - 2:57 pm, (batn)

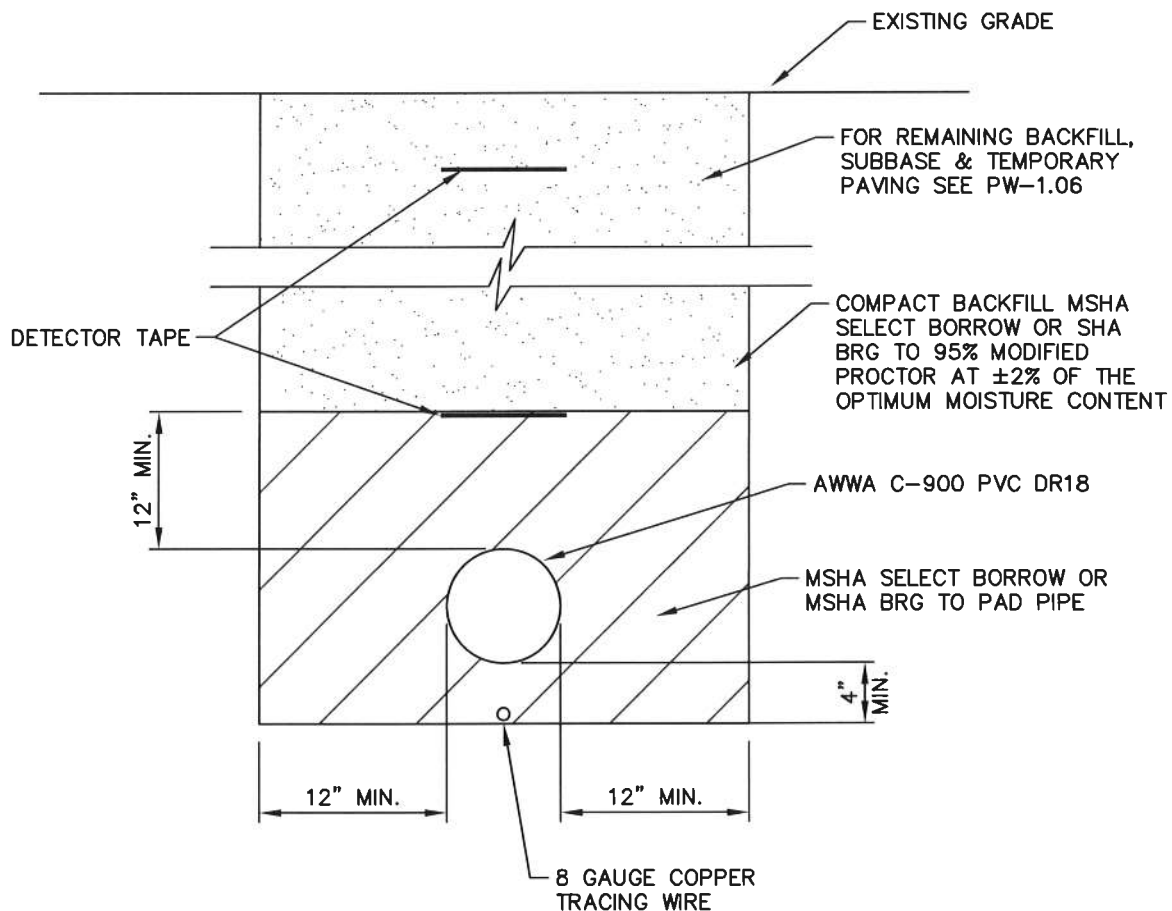

NOTES:

1. WARNING TAPE SHALL BE PLACED 12" ABOVE ALL PIPE AND 12" BELOW GROUND SURFACE.
2. THE TRACING WIRE SHALL BE A CONTINUOUS CONDUCTOR CONNECTED TO ALL FITTINGS, FIRE HYDRANTS AND SERVICES.
3. ALL FITTINGS SHALL BE AS SPECIFIED IN AWWA C110-93, MECHANICAL JOINT, DUCTILE IRON, PRESSURE RATED AT 350 PSI.
4. ALL FITTINGS SHALL BE RESTRAINED BY THRUST BLOCKS ACCORDING TO STANDARD DETAIL W-3.00.
5. FIRM BEARING SHALL BE PROVIDED FOR FULL LENGTH OF BARREL. EXCAVATE FOR BELL HOLES.

APPROVAL

*[Signature]* 4/12/11  
TOWN ENGINEER DATE

REVISED

JAN 1, 11

TOWN OF EASTON  
AND  
EASTON UTILITIES  
STANDARD DETAILS  
PVC WATER MAIN  
INSTALLATION

ISSUED: FEB 25, 2009

STANDARD NO. W-1.00